


# UDC 6300 ALARMS


**ALARM 1** - ENERGIZED OUTPUT WHEN THE PV EXCEEDS 2100 DEGREES  
(USE TERMINALS 10(-) & 6(+))

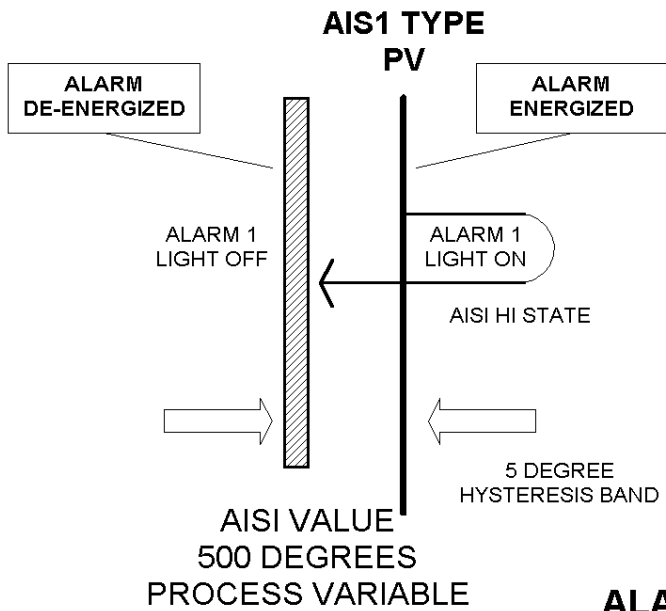

*INPUT LINEAR  
SPAN 1000 UNITS  
HYSTERESIS = 0.5*

## ALARM RELAY 1

**ALARM 2** - ENERGIZED OUTPUT WHEN THE PV GOES 10 DEGREES ABOVE OR BELOW THE SETPOINT. (USE TERMINALS 11(-) & 6(+))

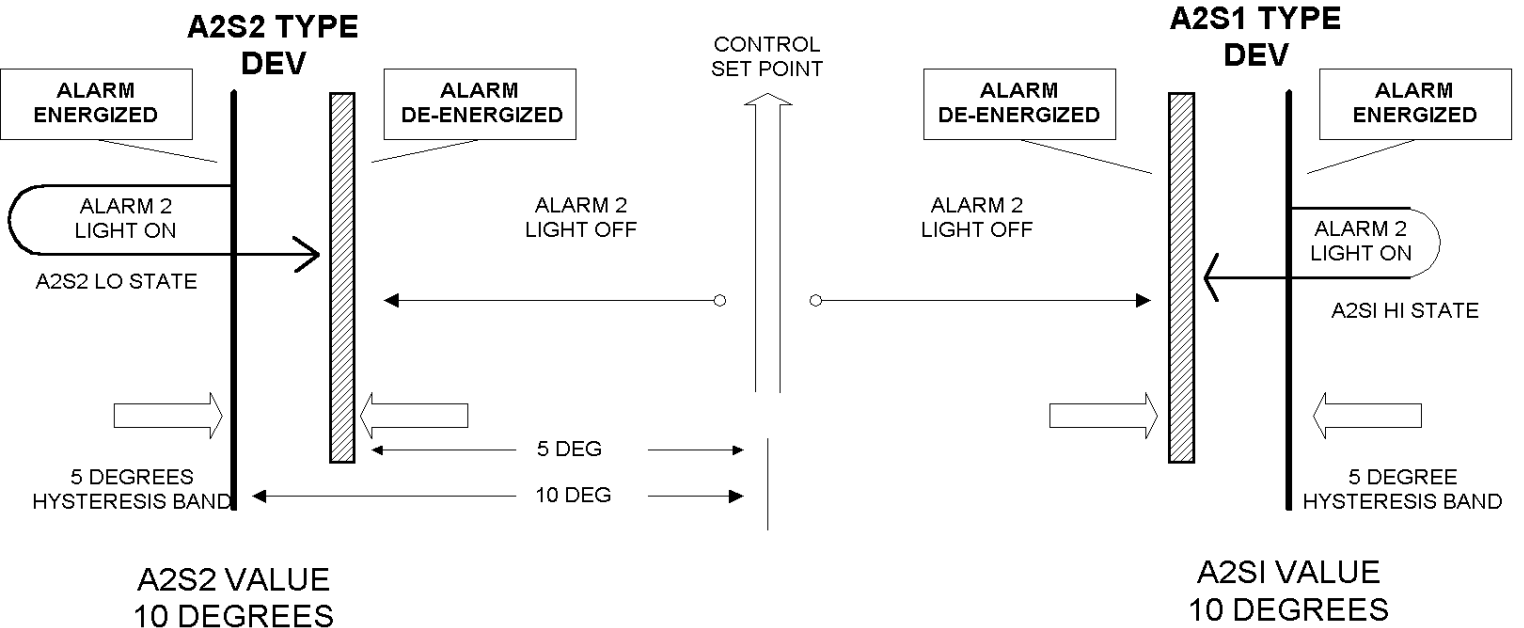

## ALARM RELAY 2