

INSTALLATION - PANEL-MOUNTING

UNPACKING THE INSTRUMENT

1. Remove the Controller from its packing. A panel gasket and a "no tools required" clamp are supplied. Retain the packing for future use (e.g. moving the Controller to a different site).
2. Examine the delivered items for damage or deficiencies. If any is found, notify the carrier immediately.

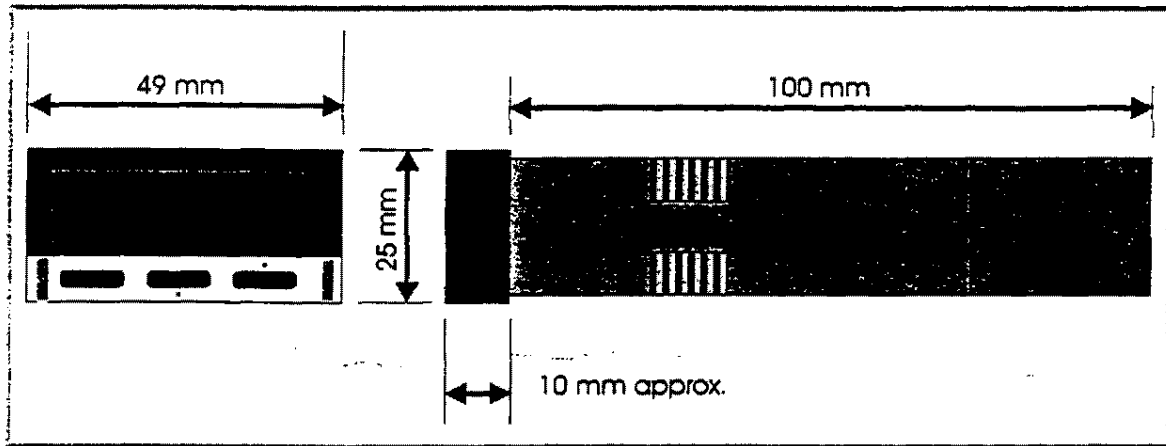


Figure 2-1 Main Dimensions


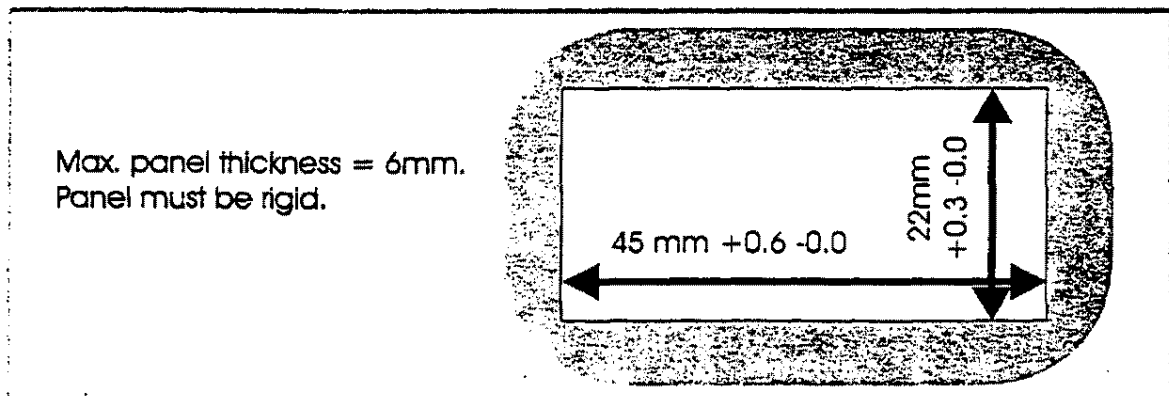


Figure 2-2 Cut-out Dimensions

INSTALLING THE CONTROLLER IN THE MOUNTING PANEL

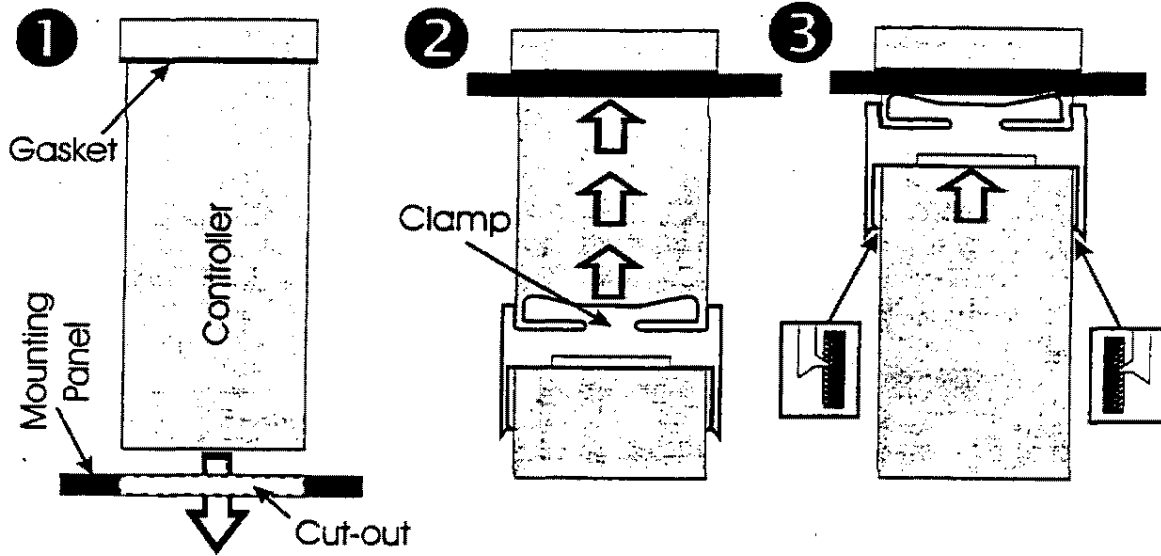

CAUTION: Do not remove the front panel gasket from the Controller, as this may cause inadequate clamping of the Controller to the mounting panel. Ensure that this gasket is not distorted and that the Controller is positioned squarely against the mounting panel. Apply pressure to the front panel bezel only.