



UDC 2500 Application Note

Mounting

Physical Considerations

The controller can be mounted on either a vertical or tilted panel using the mounting kit supplied. Adequate access space must be available at the back of the panel for installation and servicing activities.

- Overall dimensions and panel cutout requirements for mounting the controller are shown in Figure -1.
- The controller's mounting enclosure must be grounded according to CSA standard C22.2 No. 0.4 or Factory Mutual Class No. 3820 paragraph 6.1.5.
- The front panel is moisture rated NEMA3 and IP55 rated and can be easily upgraded to NEMA4X and IP66.

Overall Dimensions

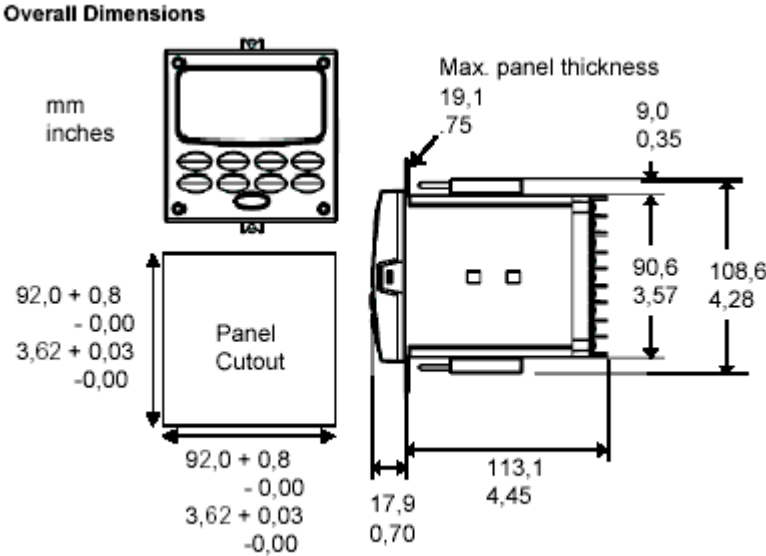


Figure -1 Mounting Dimensions (not to scale)



UDC 2500 Application Note

Mounting Method

Before mounting the controller, refer to the nameplate on the outside of the case and make a note of the model number. It will help later when selecting the proper wiring configuration.

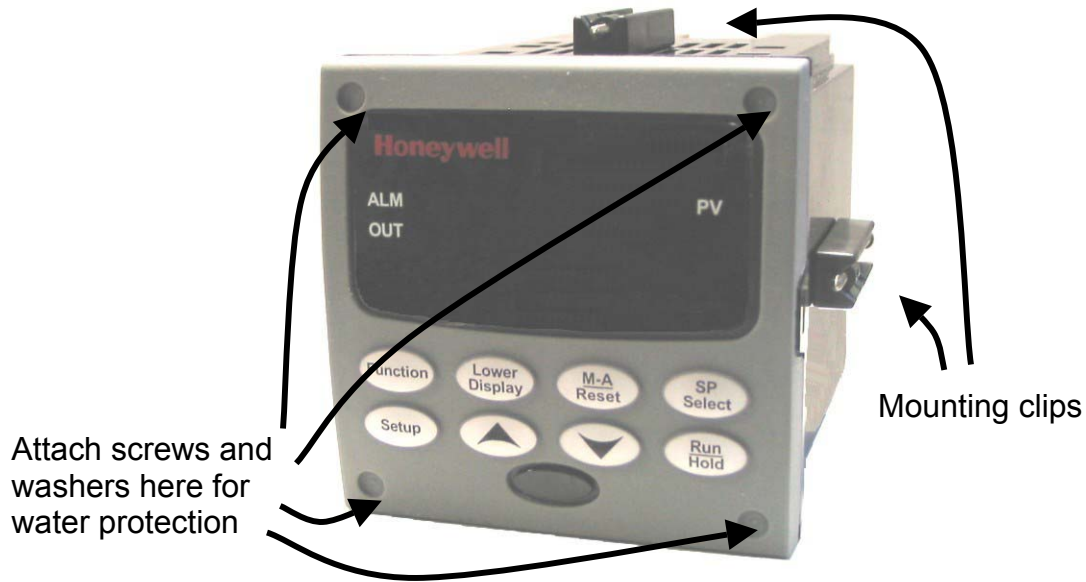


Figure -2 Mounting Methods

Mounting Procedure

Table -1 Mounting Procedure

| Step | Action |
|------|---|
| 1 | Mark and cut out the controller hole in the panel according to the dimension information in Figure -1. |
| 2 | Orient the case properly and slide it through the panel hole from the front. |
| 3 | Remove the mounting kit from the shipping container and install the kit as follows: <ul style="list-style-type: none"> • For normal installation two mounting clips are required. Insert the prongs of the clips into the two holes in the top and bottom center of the case (Figure -2). • For water-protected installation four mounting clips are required. There are two options of where to install the mounting clips: 1) Insert the prongs of the clips into the two holes on the left and right side of the top and bottom of the case or 2) on the center on each of the four sides (Figure -2). • Tighten screws to 2 lb-inch (22 N•cm) to secure the case against the panel. CAUTION: Over tightening will cause distortion and the unit may not seal properly. |
| 4 | For water-protected installation, install four screws with washers into the four recessed areas in the corners of the front bezel (Figure -2). Push the point of the screw through the center piercing the electrometric material and then tighten screws to 5 lb-in (56 N•cm). |